

# Instructions for installation

## Monolith 13,8 kW

### Wave control unit + power booster

Embedding the control panel inside a wall:  
 Width of slot: 70 mm  
 Height of slot: 70 mm  
 Depth of slot: 65 mm

Do not remove the orange plastic protection cover on the back of the panel.


Control panel can also be installed on the outside of the sauna room.

RJ10 data cable standard length is 3 metres.

10-metre cables are sold separately.

Affixing the sensor to the ceiling:  
 distance from heater frame 100–300 mm

The temperature sensor should be installed no less than 1000 mm from an undirected air vent income, or less than 500 mm from a directed air vent.

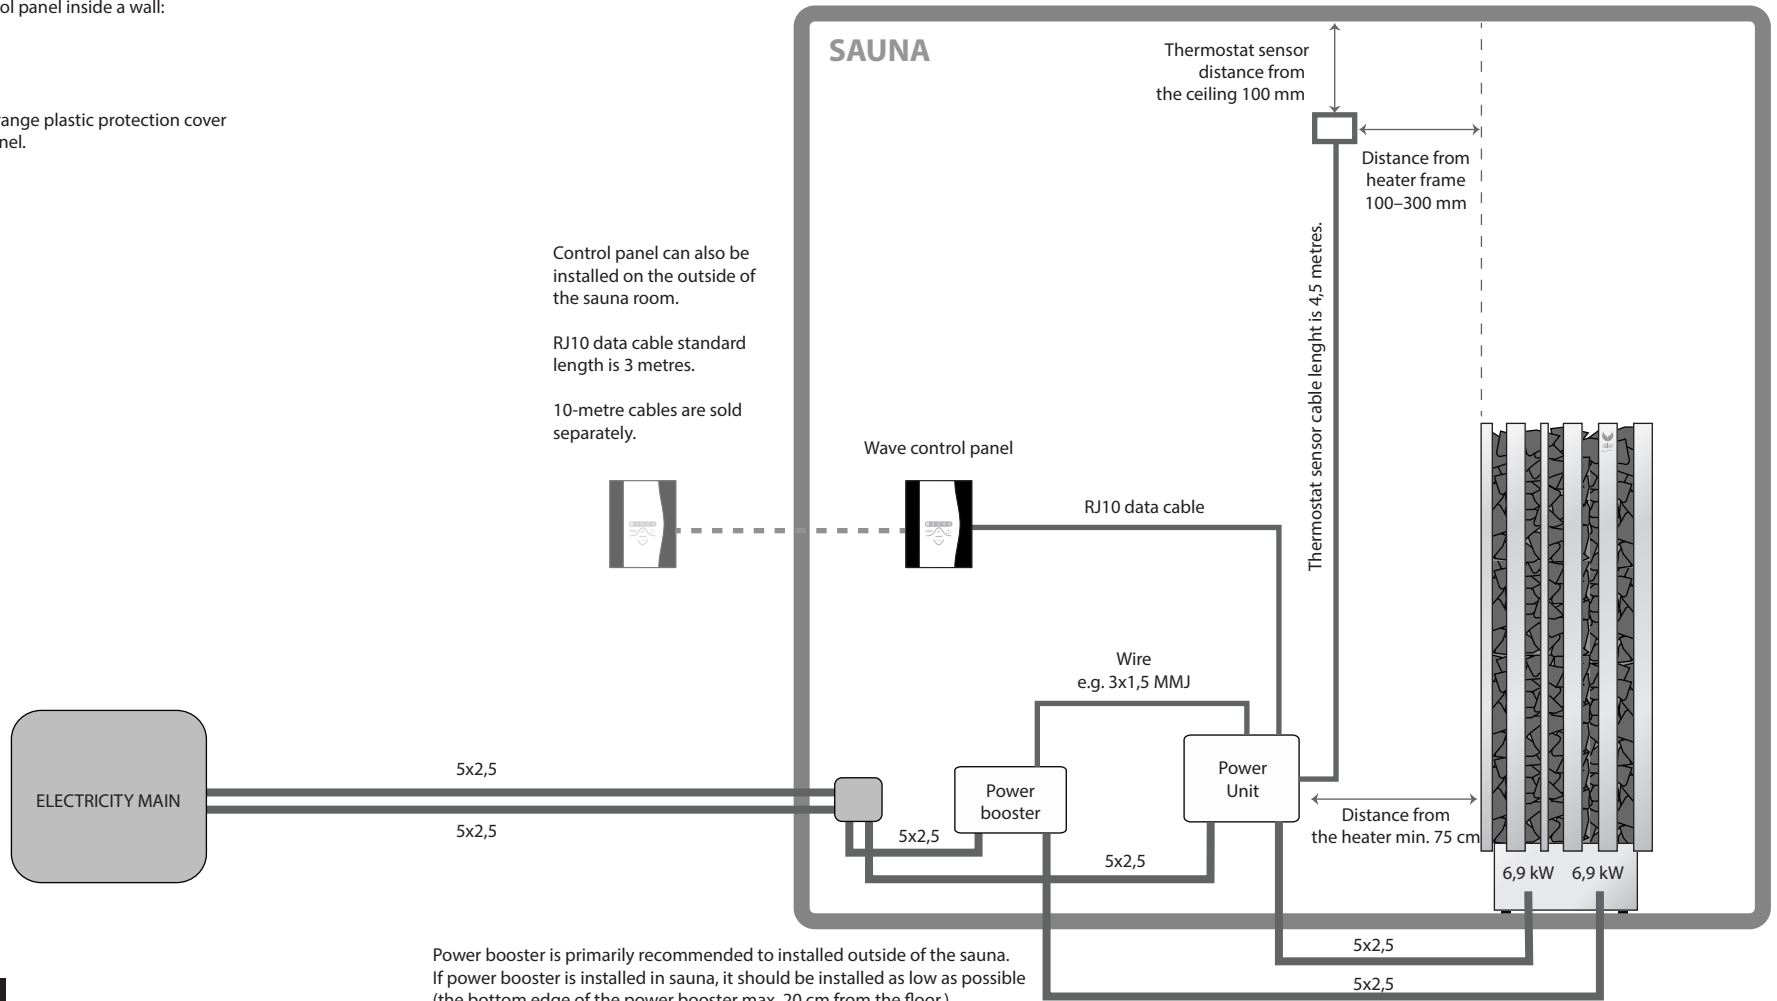

Power booster is primarily recommended to installed outside of the sauna.  
 If power booster is installed in sauna, it should be installed as low as possible  
 (the bottom edge of the power booster max. 20 cm from the floor.)

**IKI**

KIUKAISTA KIUKAIN

© IKI-Kiuas Ltd.