Instructions for installation
Monolith 9 kW
Wave Control unit

Affixing the sensor to the ceiling:
distance from heater frame 100–300 mm

The temperature sensor should be installed no less than 1000 mm from an undirected air vent income, or less than 500 mm from a directed air vent.

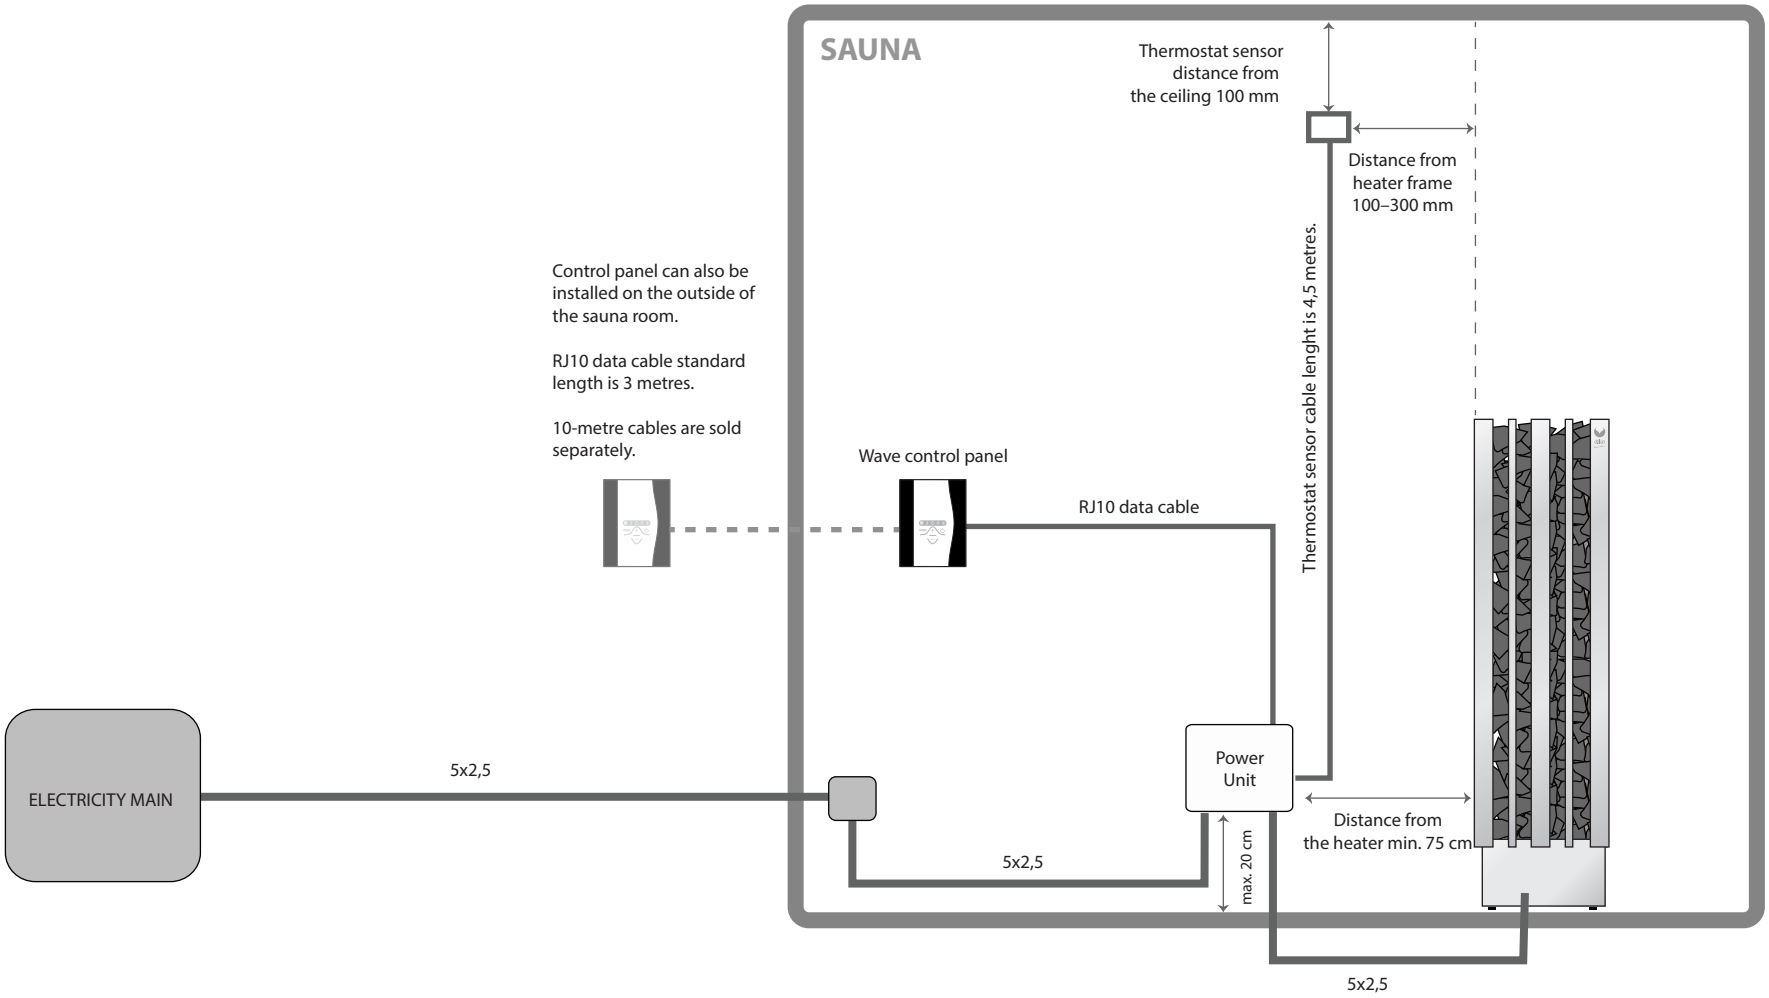

IKI
KIUKAISTA KIUKAIN

© IKI-Kiuas Ltd.